


NOTES:

1. THE ANSI Z358.1-2009 STANDARD SPECIFIES EYEWASH NOZZLE HEIGHTS TO BE 83.8cm (33 IN.) TO 114.3cm (45 IN.) ABOVE THE FLOOR AND 15.3cm (6 IN.) MINIMUM FROM WALL OR NEAREST OBSTRUCTION.
2. INSTALL SO THAT EYEWASH HEAD IS OVER SINK WHEN ACTIVATED. EYEWASH REQUIRES 4-1/2" [114mm] OF CLEARANCE AROUND HEAD FOR FACEWASH STREAMS.
3. DRILL ONE Ø7/8" [22mm] HOLE AND ONE Ø3/32" HOLE WHERE UNIT IS TO BE INSTALLED. REFER TO MOUNTING HOLE DETAIL.
4. THESE DIMENSIONS MAY VARY ±1/2" [6.4mm].

SEE MOUNTING HOLE DETAIL

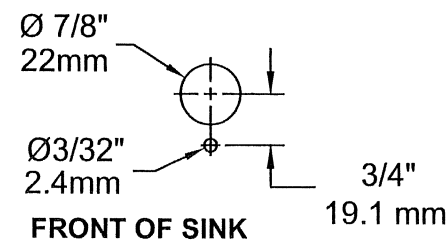

2 3 MOUNTING HOLE DETAIL

		1455 KLEPPE LANE SPARKS, NEVADA 89431 (775) 359-4712 FAX (775) 359-7424 E-MAIL: HAWS@HAWSO.COM WEBSITE: WWW.HAWSO.COM	
ECN NO. 2066 DRAWN: JF APPROVED: JF	REVISED PER: IR DATE: 10/98 CHKD: JF	MODEL(S) 7610 PULL DOWN EYE/FACE WASH	PART NUMBER 0002080067.D DRAWING NO. 12691A00 REV 11
SCALE: 1:8 DATE: 11/28/11		DRAWING TYPE: INSTALLATION	SIZE: A SHEET 1 OF 1